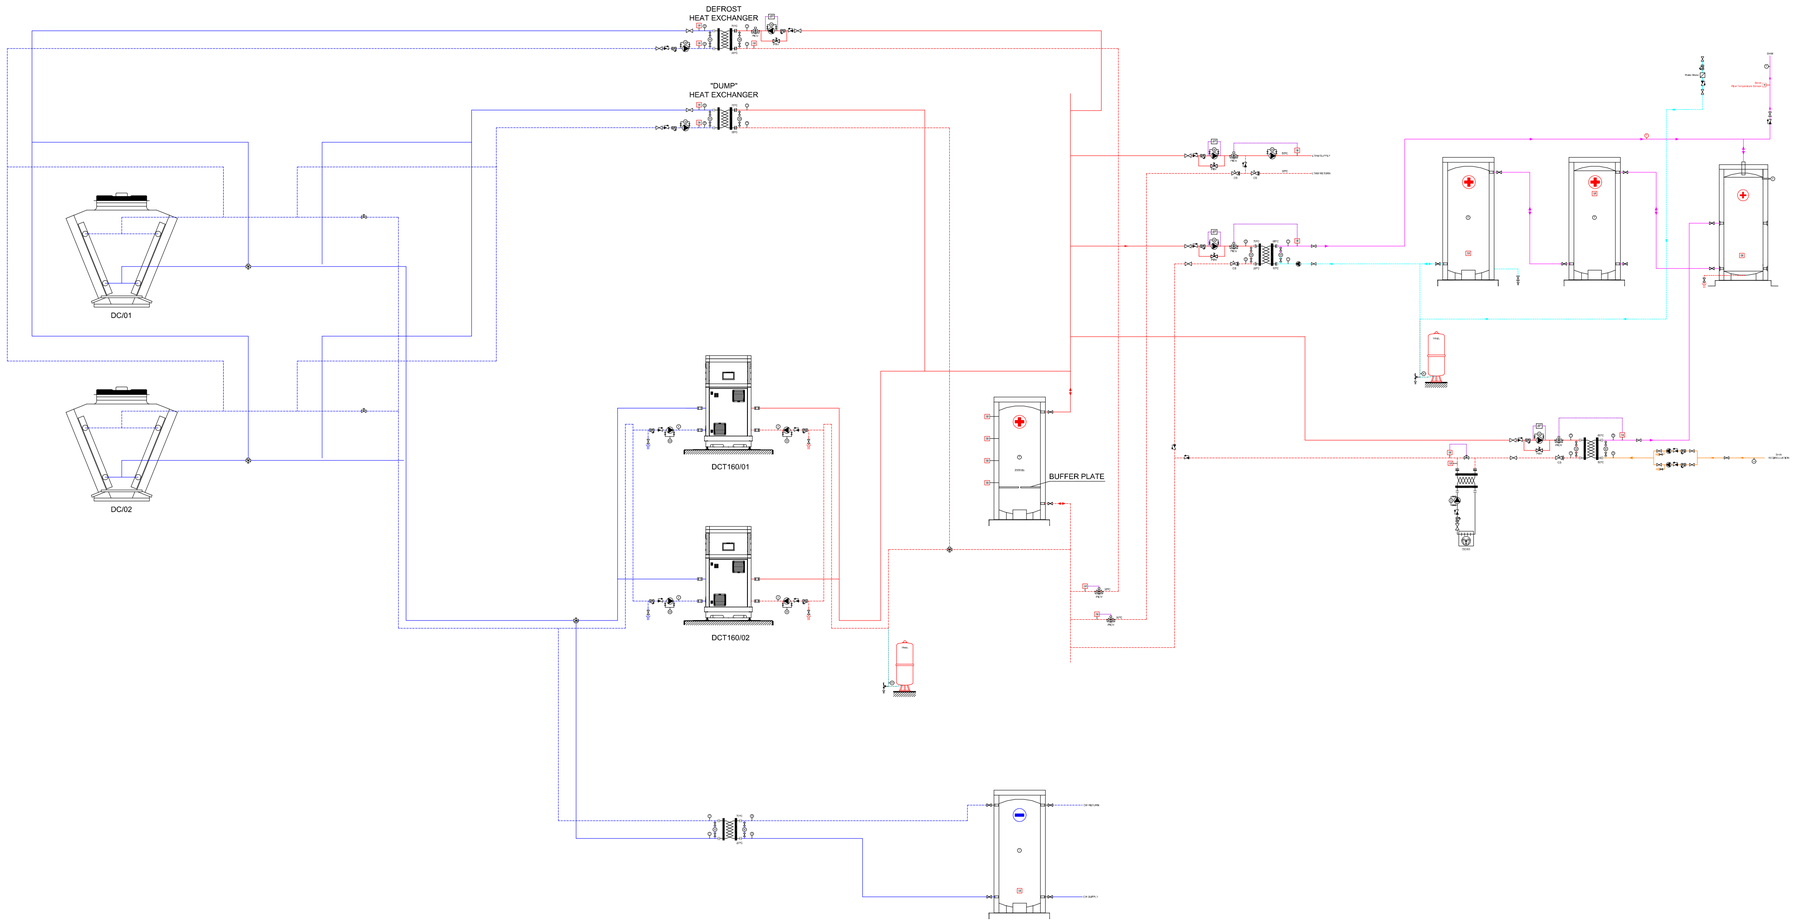

NOTES:

- The heating of the DHW recirculation is done with a plate heat exchanger; a dry cooler is necessary to reduce the return water temperature to the DCT heat pumps.

Rev	Date	Details
P1	**/**/**	PRELIMINARY ISSUE FOR COMMENT

Drawing Title:

Hydraulic Diagram

DCT One Heat Pumps

DALRADA
Climate Technology